


Revisjoner			
Revision	Sign.	Description	Date
B	SLN	Terrain level raised, outlet level lowered. Revisions to placements of flowmeter + valves.	18-11-2022
C	SLN	Step distance revised - Step inclination drawing added on page 2	29-11-2022
D	SLN	Additional production dimensions added on page 3	30-01-2023
E	CVR	Nye koter og buk på sugerør	18-07-2023

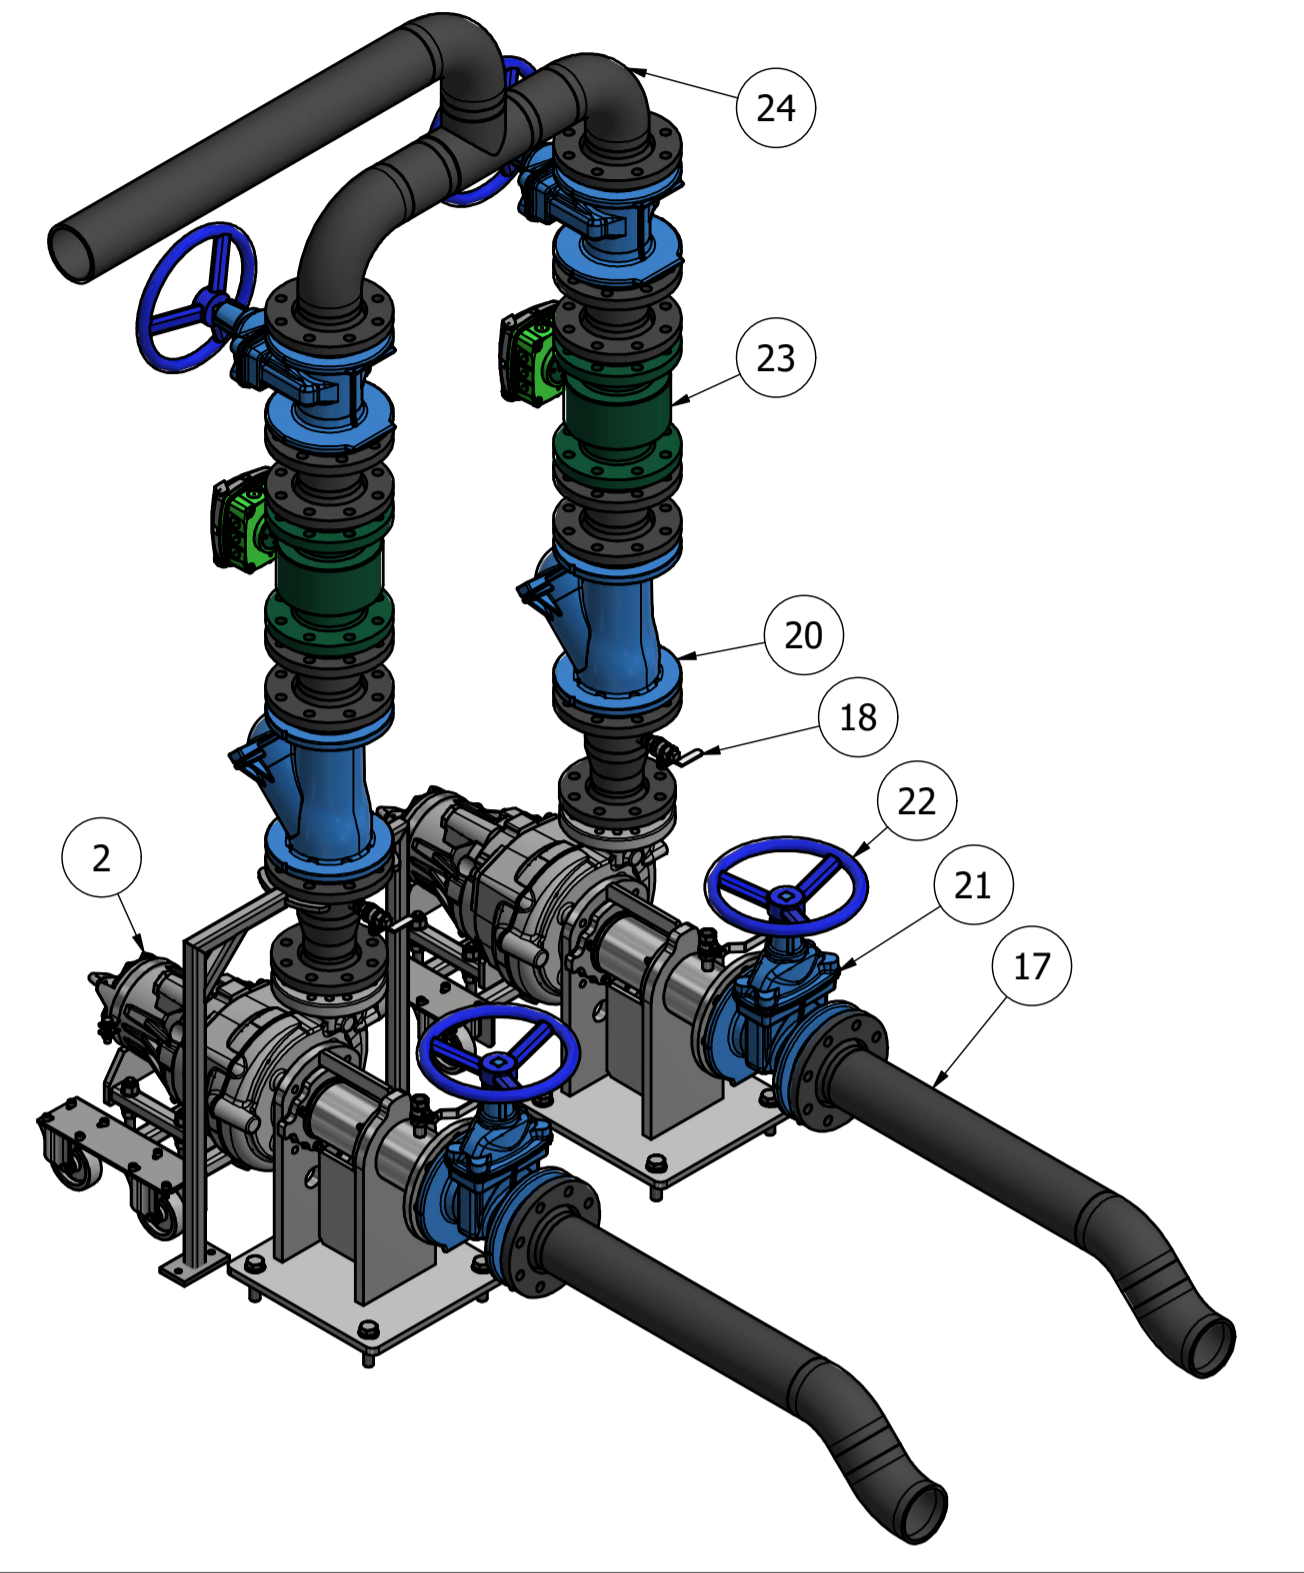

Stykliste					
Pos.	Pcs.	Description	Matr.	Dim.	Supplier
31	1	Level sensor	Coated		Xylem
30	3	Pipe clamp	AISI316	Ø110	Xylem
29	1	Mount for controlpanel	PE		Xylem
28	1	Hot water pipe	AISI316	DN20	Xylem
27	1	Cold water pipe	AISI316	DN25	Xylem
26	3	Electrical pipes	PE	Ø110	Xylem
25	2	Electrical pipes	PE	Ø63	Xylem
24	1	Manifold	PE100 SDR17	Ø110	Xylem
23	2	MagFlux Flowmeter		DN100	Xylem
22	4	Valve Wheel	AISI 304	DN100	Xylem
21	4	Gate Valve	Coated	DN100	Xylem
20	2	Check Valve	Coated	DN100	Xylem
19	2	Pressure pipe	PE100 SDR17	Ø110	Xylem
18	4	Ball valve	AISI316	1/2"	Xylem
17	2	Suction Pipe	PE	Ø110	Xylem
16	1	Tee-Pipe	PE100 SDR17	Ø160	Xylem
15	1	Overflow pipe	PE100 SDR17	Ø160	Xylem
14	2	Inlet pipe	PE100 SDR17	Ø160	Xylem
13	2	Pressure pipe at Bilge Pump	Rubber	Ø50	Xylem
12	1	Bilge Pump			Xylem
11	1	Spiral staircase	Steel		Xylem
10	1	Concrete top	Concrete		
9	1	Concrete ring	Concrete		
8	1	Ventilator	Generic	Ø125	Xylem
7	1	Vent pipe - Intake	PE		Xylem
6	1	Lid/Cover w. Safety Grid	Aluminium	Ø1250	Xylem
5	1	Well Tube - Sump	PE	Ø1250	Xylem
4	1	Cover w. Safety Grid at stairwell	Steel	2000x1000	Xylem
3	1	Cover w. Safety Grid (small)	Steel	600x600	Xylem
2	2	NZ 3085 MT - Pump Assembly			Xylem
1	1	Well Tube	PE	Ø3000	Xylem

Vatnsvirkinn EHF

Scale: 1:25

Date: 18-07-2023 CVR

Rev.: 30-01-2023 SLN

Quote No.: 221141-2-1

Project No.: 22P228

Drawing No.: 00920

Rev.: E

Pump Station
w/ 2 x NZ 3085 MT

This drawing may not be copied, presented to other companies and individuals, or used in a way that conflicts with Xylem's interests.